

## **Notice of Water Service Line Material Confirmation**

July, 2023


Dear Manasquan Resident:

### **INTRODUCTION**

In July 2021, New Jersey enacted Public Law P.L. 2021 Chapter 183 requiring all community water systems to replace residential and commercial lead and galvanized fresh water service lines in their service area. The mandate must be fully satisfied within 10 years of the passage of the law, i.e., by July of 2031. Under the law, the Borough of Manasquan is preliminarily required to identify and inventory all public and private water service to line materials within its jurisdiction. The Borough's water service line inventory is currently available on our website at: <https://www.manasquan-nj.gov/watersewer-department>. Currently, the Borough's on-line published inventory only identifies each property address as the Borough commences the process to identify and confirm the service line's material.

### **IDENTIFICATION OF THE ISSUE**

This below example depicts the typical water service connection from the Water Main to the structure:

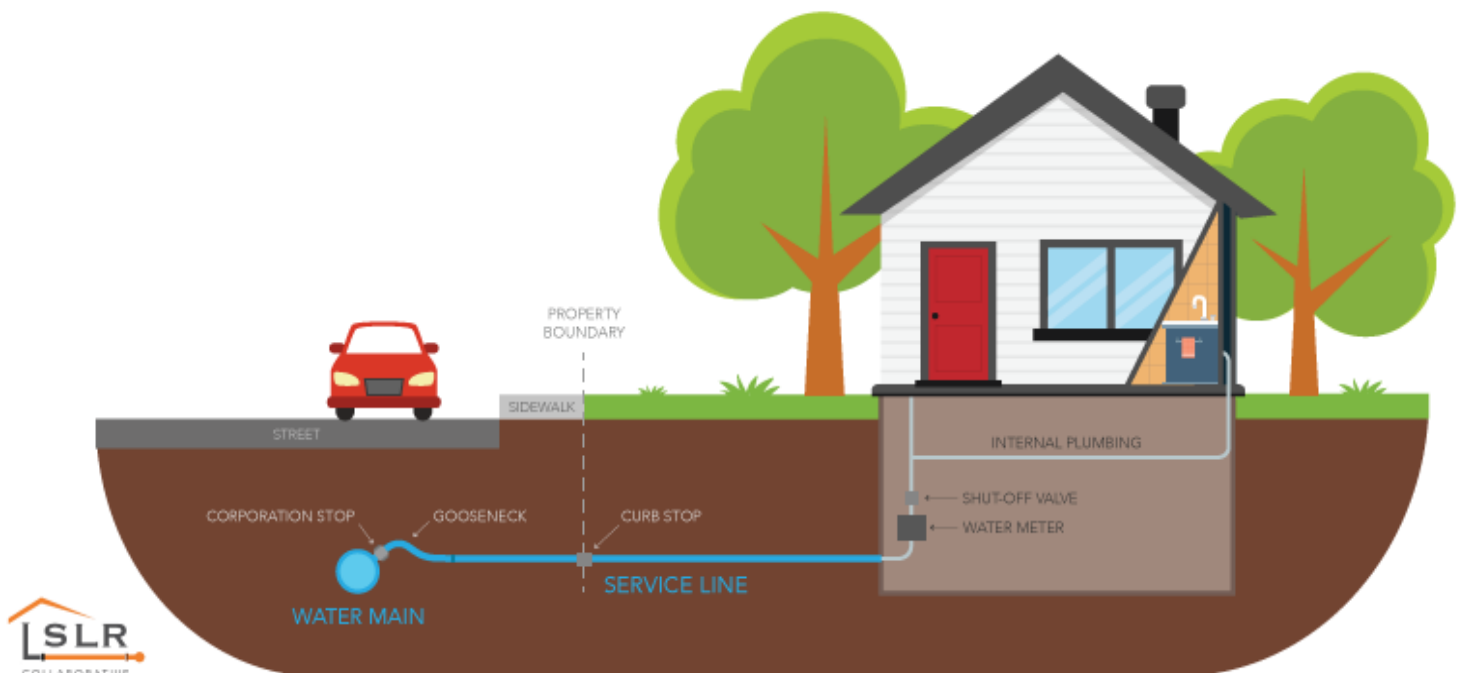

A Water Service Line is the portion of pipe that connects the Water Main to the Structure Inlet. By Manasquan Ordinance the property owner owns and is responsible to maintain the Service Line wholly from the Corporation Stop to the Water Meter. PL 2021 Chapter 183 supersedes the Borough's Ordinance to the degree that it places upon the Borough the responsibility to replace lead and galvanized service lines.

#### **A REQUEST FOR YOUR ASSISTANCE**

- 1) The pipe material of your Water Service is not recorded or identified within the Borough's records. The Borough is seeking your assistance in its effort to fully comply with its statutory mandate. If you know the type of pipe material of your Water Service Line, you are requested to please notify the Manasquan Water Department utilizing this online link.
- 2) If you are unsure of the type of pipe material, we ask that you complete the enclosed questionnaire and mail it back to the Borough in the enclosed envelope.
- 3) If after referring to the questionnaire you remain unsure of the type of your structure's pipe material please email the Borough at the address below and set an appointment to have a technician visit to identify the pipe material that enters your residence to connect to the Structure Inlet.

For any other questions regarding this matter, please contact Ryan Travers, Manasquan Water Department Supervisor via email or phone.

Email: [rtravers@manasquan-nj.gov](mailto:rtravers@manasquan-nj.gov)

Phone: (732) 223-0544, ext. 550

Thank you for your cooperation with this important initiative.

Sincerely,

Ryan Travers

Water & Sewer Division Supervisor

## Borough of Manasquan – Water Service Material Identification Survey

Name: \_\_\_\_\_

Address: \_\_\_\_\_

Contact Information: \_\_\_\_\_

Please Identify your water service material type and return to the Borough via mail or email.

Borough Mailing Address: 201 East Main Street, Manasquan, NJ 08736

Email Address: [rtravers@manasquan-nj.gov](mailto:rtravers@manasquan-nj.gov)

☐ **Copper Pipe**



☐ **Galvanized Pipe**



☐ **Polyethylene (Plastic) Pipe**

